


Broomfield VascLab	1-1-11	1-1-11
Hosp Number 12345	Consultant IP	Date exam 12-04-2018

LOWER LIMB COLOUR DUPLEX VENOUS ASSESSMENT

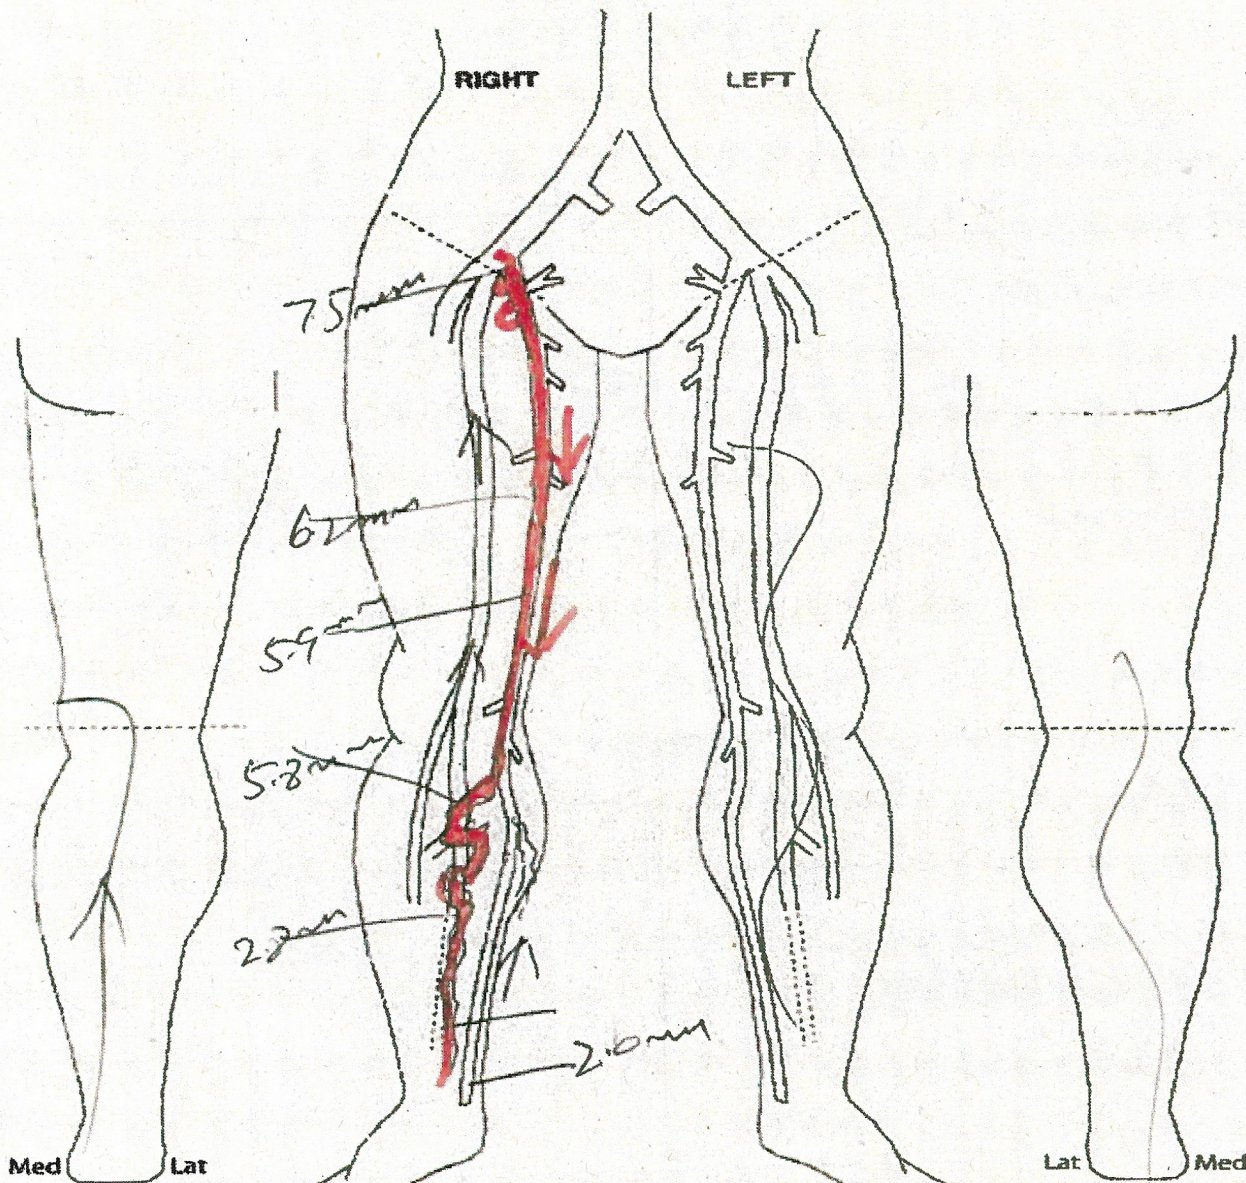

Right Leg;  
 Recurrent tortuous, incompetent LSV at SFJ diameter 7.5mm.  
 LSV is incompetent in thigh diameter 5.9mm to 7.5mm and competent below knee.  
 Below knee incompetent varicose vein arises anteriorly diameter. 2.8mm.  
 SSV and deep veins are patent and competent.

Scan performed and reported by: Ikhlaz Rana